

U34

Material Data Sheet



Material Description & Properties

Agglomerated recycled rubber resilient layer for impact noise insulation of floating screed.

PRODUCT SPECIFICATION

"___mm resilient acoustic underscreed made of agglomerated recycled SBR (Styrene Butadiene Rubber) with PU (polyurethane) elastomer bonding agent for impact noise insulation of floating screeds, with a density of 550kg/m³ and an impact noise reduction ΔL_w of ___dB."

KEY FEATURES

- Impact noise reduction and thermal insulation properties
- Very easy to handle and long term resilience
- Produced from post consumer recycled rubber
- Very flexible

THERMAL PROPERTIES

Thermal Conductivity: 0.140 W/mK ⁽¹⁾

⁽¹⁾ ISO 8301

PHYSICAL AND MECHANICAL PROPERTIES

Specific Weight ⁽¹⁾	550 Kg/m ³
Tensile Strength ⁽²⁾	> 250 KPa
Recovery after 0.7MPa ⁽³⁾	> 80%
Dynamic Stiffness ⁽⁴⁾	*

⁽¹⁾ ASTM F1315 • ⁽²⁾ ASTM F152 • ⁽³⁾ ASTM F36 • ⁽⁴⁾ ISO 9051-1 & ISO 7626-5

* Test being performed

ACOUSTICAL RESULTS

Thickness (mm)	8/4
ΔL_w (dB) ⁽¹⁾	24
IIC (dB) ⁽²⁾	54

Thickness (mm)	17/8
ΔL_w (dB) ⁽¹⁾	29
IIC (dB) ⁽²⁾	49

⁽¹⁾ ISO 10140-3 and ISO 717-2 • ⁽²⁾ ASTM E492-09 & ASTM E989-06


STANDARD DIMENSIONS

Thickness (mm)	8/4	17/8
Width (m) x Length (m)	1x15	1x9

Others sizes available upon request

ACOUSTICAL RESULTS

Test procedure according to ISO 10140-1:2010; ISO 10140-3:2010; ISO 10140-4:2010 and ISO 717-2:2013 standards.

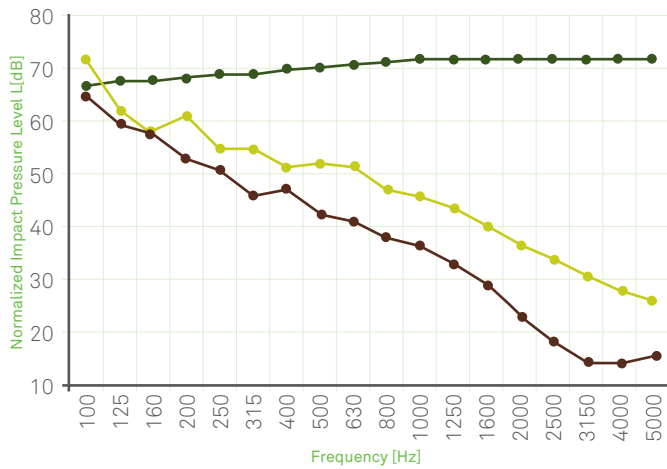


$L_{n,r,0}$ (dB) $L_{n,r}$ (dB) - 17/8mm
 $L_{n,r}$ (dB) - 8/4mm

$L_{n,r}$ - Normalized impact sound pressure level of the reference floor with the floor covering under test;
 $L_{n,r,0}$ - Normalized impact sound pressure level of the Lab reference floor;
 ΔL_w - Impact sound pressure level reduction index of the covering under test, on a normalized floor;

Ref. Test Report	ACU 118/09
Thickness	8/4 mm
$L_{n,r,w}$ ($C_{l,r}$)	54(4) dB
ΔL_w ($C_{l,\Delta}$)	24(-15) dB
Ref. Test Report	ACL 009/15
Thickness	17/8 mm
$L_{n,r,w}$ ($C_{l,r}$)	49(3) dB
ΔL_w ($C_{l,\Delta}$)	29(-14) dB

ACOUSTICAL RESULTS

Test procedure according to ISO 10140-1:2010; ISO 1040-3:2010 and ISO 10140-4:2010 standards. Normalized impact sound pressure level and IIC rating determined according ASTM E492-09 and ASTM E989-06 standards.

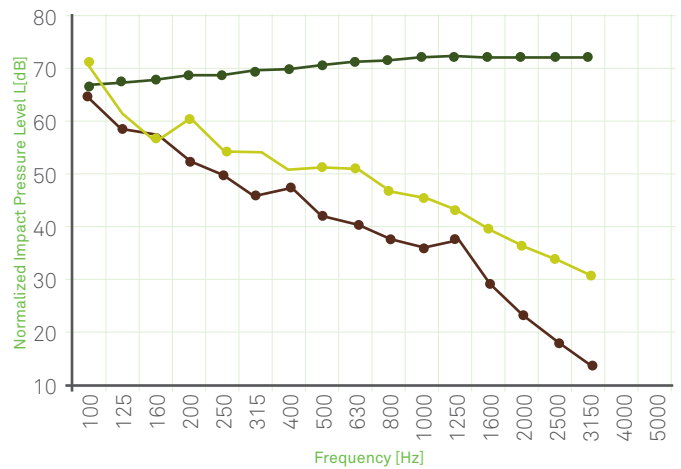


$L_{n,r,0}$ (dB) $L_{n,r}$ (dB) - 17/8mm
 $L_{n,r}$ (dB) - 8/4mm

$L_{n,r}$ - Normalized impact sound pressure level of the reference floor with the floor covering under test;
 $L_{n,r,0}$ - Normalized impact sound pressure level of the Lab reference floor;


Thickness	IIC _c
8/4 mm	48 dB
17/8 mm	55 dB

TEST APPARATUS (ΔL_w & IIC)

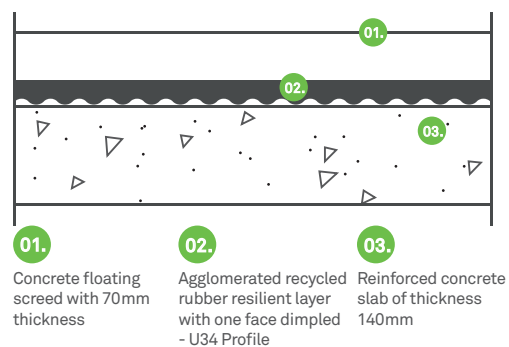


PHYSICAL AND MECHANICAL PROPERTIES

LOAD DEFLECTION

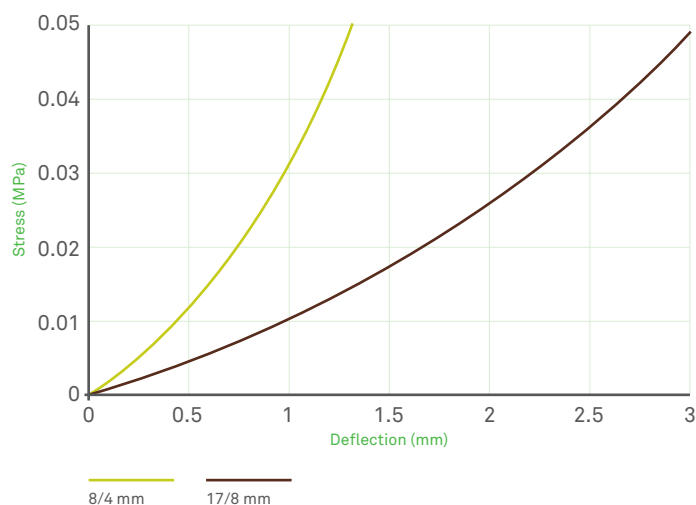

CREEP DEFLECTION @ 0.0045MPa (% OF START HEIGHT)

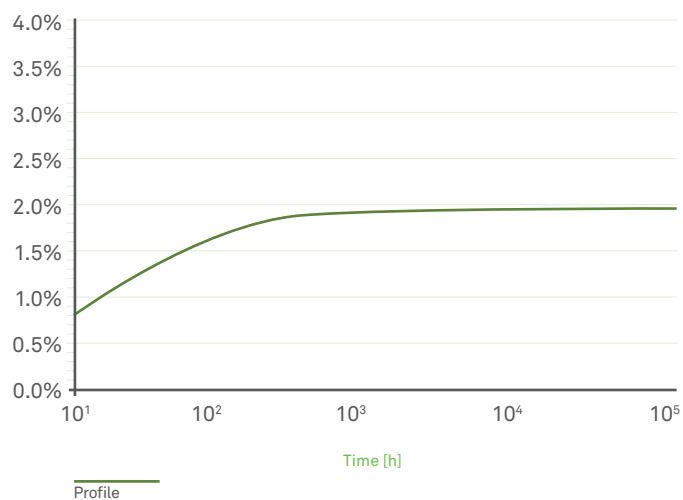

Note: Following ISO8013-1998 measured in Cantilever Test System


DYNAMIC STIFFNESS

Test procedure according ISO 9052-1 and ISO 7626-5 standards.

Thickness (mm)	8/4mm	17/8mm
Dynamic Stiffness (MN/m ³)	*	*

*Test being performed

INSTALLATION

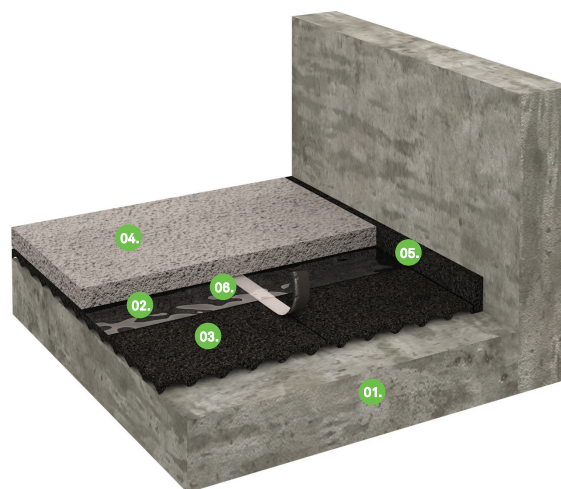

01.

Reinforced
concrete slab

02.

Vapor
barrier

03.

Agglomerated recycled rubber
resilient layer with one face
dimpled - U34 Profile

04.

Concrete floating
screed

05.

Perimeter insulation
barrier

06.

Adhesive tape

GENERAL INSTALLATION INSTRUCTIONS

The following installation instructions are recommended by Amorim Cork Composites, but are not intended as a definitive project specification. They are presented in an attempt to be used with recommended installation procedures of the flooring manufacturers and screed.

Room Conditions


Temperature > -5°C / Room moisture content < 75%.

Subfloor

All subfloor work should be structurally sound, clear and level. The moisture content of the subfloor should not be more than 2.5% (CM) by weight measured on concrete subfloors.

Perimeter Insulation Barrier

Install a perimeter insulation barrier vertically around the entire perimeter of the room with width equal to that of the floor build up. This is highly recommended in order to avoid lateral propagation of impact noise. The barrier must also be applied in the perimeter of pipes, ducts or any other component protruding from the floor. Spot adhere the strips to the wall using acrylic glue or a bead of silicone sealant.

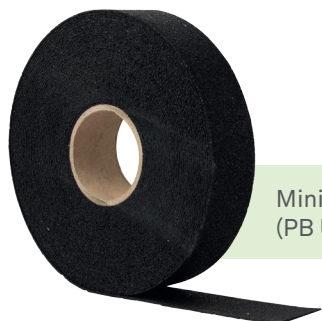

Mini-rolls of perimeter barrier (PB U34) available upon request.

Installation Instruction for Acousticork U34

Unpack the Acousticork U34 at least 24h before the installation and store it in the room where the installation will take place. Cut and trim the Acousticork U34 to the desired size to fit the installation. Apply directly over the subfloor. Always ensure that material is installed to fit the application avoiding the creation of waves in the material. In case of profile material, dimple side must face down.

Place the Acousticork U34 directly against the insulation perimeter barrier already installed. Proceed to cover the entire floor making sure that the joints are butted tight and use an adequate tape to fix it. After completion, the Acousticork U34 should cover the entire flooring area without gaps and with joints securely taped. A waterproof membrane (ex. Polyethylene foil) minimum 0.2mm covering the entire flooring area MUST be installed prior to the screed. Install it, minimum 150mm wide vertically and overlapping it, minimum 100mm. After completion, the insulation vapour barrier should cover the entire Acousticork U34 area without gaps. Never mechanically fasten the Acousticork U34 and/or the PE foil barrier with screws, nails or staples as this will severely diminish the performance of the insulation barrier.

Screed and Final Flooring

Cast a suitable screed over the loose laid PE foil previously installed over the product.

Always follow manufacturers recommended installation instructions.

For detailed installation instructions, please contact us.



The mark of responsible forestry

